


Tik kvalifikuotas personalas gali atlikti šviestuvo montavimą ir pajungimą.

The installation has to be carried out by an electrician or by any similarly qualified person.



	CCT	A,mm	B, mm	KG		CCT	A,mm	B, mm	KG
STEELO 1.4m 40W 840	4000K	1367	1184	3.3	STEELO 1.6m 80W 840	4000K	1653	1473	3.8
STEELO 1.4m 60W 840	4000K	1367	1184	3.3	STEELO 1.6m 110W 840	4000K	1653	1473	3.8

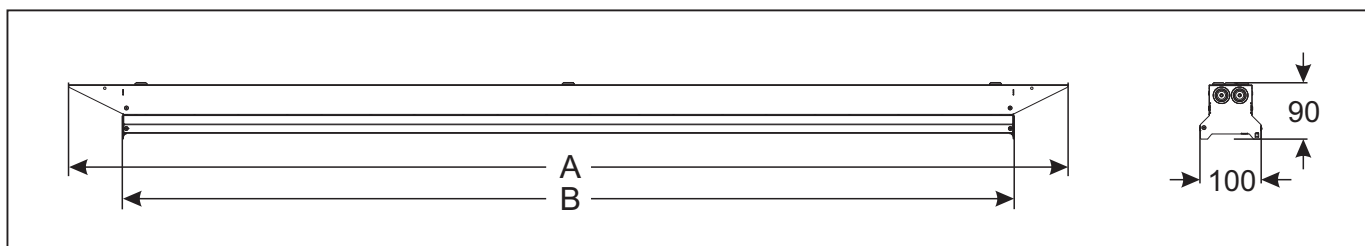

Automatic circuit breaker type	B10	B16	B20	C10	C16	C20	Inrush current	
Installation Ø	1.5 mm ²	2.5 mm ²	2.5 mm ²	1.5 mm ²	2.5 mm ²	2.5 mm ²	I _{max}	Time
STEELO 1.4m 40W	20	33	42	34	56	70	22A	191 µs
STEELO 1.4m 60W	17	28	35	29	47	58	33A	162 µs
STEELO 1.6m 80W	14	23	29	24	38	46	39A	166 µs
STEELO 1.6m 110W	9	15	19	16	25	31	41A	221 µs

1a

TVIRTINIMAS PRIE LUBŲ / CEILING MOUNTING

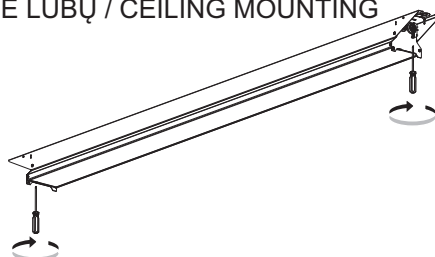

1b

TVIRTINIMAS ANT LYNO / CATENARY WIRE MOUNTING

